

Testing precautions

Once the fitting is permanently connected to the mains supply, a commissioning discharge test as required in AS/NZS 2293.2 must be carried out. You will need to allow 24 hours for the battery to fully charge prior to conducting this test, presently (at the time of writing), the standard requires that fittings operate in emergency mode for a period not less than 2 hours for their commissioning test and for not less than 90 minutes thereafter (it is required that 6 monthly discharge tests be carried out). You will need to keep the records for the commissioning test and enter them into the building emergency services logbook or via other recording methods as allowed by AS/NZS 2293.2.

Construction sites

Continuously switching off the mains power supply that is connected to emergency light fittings during the construction phase of an installation will cause these fittings to discharge and charge their batteries many times over a short period; this can shorten life of the battery. ABB does not recommend such practices and may not honour the warranty on batteries when they are subjected to such harsh operating conditions. Emergency light fittings are designed to be discharge tested once every 6 months as per AS/NZS 2293.2, subjecting the product to repeated discharge or charge cycles is regarded as an abuse of the fittings.

Troubleshooting guide

If you have installed and connected the fitting as per the instructions listed earlier and it does not function correctly, use the following table as a guide to fixing the problem. Look up the type of fault in the left column and check the possible causes from the right column.

If the fitting still does not work after checking these possible causes, contact ABB customer service in Australia on 1800 60 20 20.

No.	Fitting type	Fault	Possible causes
1	Standard Nexus LX Nexus RF	LEDs do not light up when connected to mains	AC supply not connected or turned off; or Switch active turned off; or LEDs damaged
2	Nexus LX	Indicator LED is flashing green but AC lamp does not come on when connected to mains	Switch active turned off; or Lamp damaged; or Missing loop from unswitched to switched active
3	Nexus LX	Indicator LED is flashing green but lamp does not come on when test switch is pressed	Switch active turned off; or LEDs damaged; or Battery pack not connected or faulty; or Test switch damaged
4	Nexus LX	Indicator LED does not light up red after the commissioning	Battery pack not connected; or LED wire not properly inserted into the terminal
5	Standard Nexus LX Nexus RF	LEDs are lit momentarily when test switch is pressed or when mains fail	Battery not fully charged (allow up to 24 hours); or Battery pack damaged
6	Nexus LX	Indicator LED is constant green	Fitting self checks fail - return to manufacturer
7	Nexus LX Nexus RF	Fitting LED is not flashing yellow/orange under wink node command	Fitting is not receiving communication signal Check data cable wiring path and cable or RF connections Refer to Nexus user and technical guide

ABB Australia Pty Limited

For enquiries
ABB contact centre: 1800 60 20 20
E-mail: AU-ABB-Stanilite@abb.com

INSTALLATION MANUAL

Stanilite® Batten LED weatherproof Emergency, Nexus® LX, Nexus RF



Thank you for choosing ABB product

Please read this document thoroughly before commencing installation and retain for future reference. Contact ABB customer service in Australia on 1800 60 20 20 if you need any assistance. The installation instructions were correct at the time of print. To reflect changes in technology and Australian standards; ABB reserves the right to amend the instructions without notice. Updated document can be found on the Stanilite website.

Safety warning

In Australia and New Zealand, only licensed electricians are permitted by law to work with 240 volt electrical installations. Do not attempt to install or connect this product unless you are a licensed electrician. Turn off and isolate the electrical supply before connecting this fitting to the building wires. Do not touch the terminals of the terminal block when the light fitting is energised. The only user-serviceable part is the battery pack. The LED light source contained in this luminaire shall only be replaced by the qualified person. Do not attempt to service other parts of the fitting as this will void the warranty. As the installer, it is your responsibility to ensure compliance with all relevant building and safety codes, (ie: AS/NZS 3000, AS/NZS 2293). Refer to

This document covers	What's inside the box
Safety warning	Batten LED weatherproof
Installation instructions	Installation kit
Removal instructions	Installation manual
Testing precautions	Warranty information
Troubleshooting guide	

the applicable standards for data and mains cabling installation procedures and requirements.

Important to note:

- This product is designed for indoor and outdoor use.
- Not suitable for installations where exposure to direct sunlight may occur.

Nexus LX (data cable system)

The Nexus range of emergency light fittings are designed to be connected together into a special communication network over a level 4 (or higher) high speed, single twisted pair data cable. The Nexus user and technical guide describes all you need to know to successfully install a Nexus project. Ask for it from your supervisor, from your employer or from your nearest ABB product supplier. The network cabling of the building must be installed as per the procedure detailed in the Nexus user and technical guide. No mains or mains carrying cables are to be connected to the data terminals or cables.


Nexus RF (wireless system)

The Nexus RF range of light fittings are designed to communicate via a proprietary RF network, however the electrical installation of the fittings is identical to that of a standard non-monitored fitting.

Installation instructions

1. Remove the diffuser from the base.
2. Rotate the gear tray retaining clips (2) to remove the gear tray from the base.
3. The batten can be either ceiling or wall mounted, or suspended. For ceiling installation; mark the position of the mounting brackets using the distance LF as shown in table below. Use the mounting bracket as a template to mark mounting bracket screw locations. For wall mount installation; it is recommended to use the 45 degrees mounting brackets (sold separately under part number 26-PBMD001) to maximise the light output.

Note: Avoid drilling any hole through the base housing. If a sealing compound is used, it must be of the neutral cure type. It is the responsibility of the installer to install the fitting correctly to maintain the batten's IP integrity.

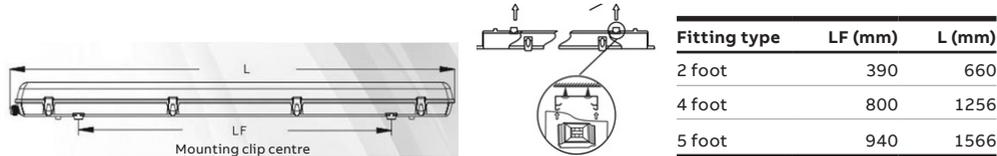

4. Secure the mounting brackets (2) to the ceiling/wall using appropriate fixings (fixings suitable for installation into concrete are supplied, for other mounting surfaces use appropriate fixings depending on the type of building construction materials used).
5. A pre-drilled cable access hole is available. If alternative access is required drill the case to suit the cable gland. We recommend to use the provided cable gland (20mm hole), 1 cable sealing bush and 1 cable gland (20mm hole) are supplied.
6. Run mains cable as appropriate through the base access hole via a sealing grommet or gland provided to maintain the IP rating of the fitting.
7. Attach the gear tray to the base via the lanyards provided.
8. Strip 9mm insulation length from mains cable, connect and terminate wires to the terminal block. Be careful with multi-strand conductors that all the strands are twisted together before insertion into the terminal. Any stray strands that inadvertently come into contact with their neighbouring terminal will cause undesirable results when the fitting is powered.

Wire/fitting type	Non-maintained	Maintained - no SA	Maintained - with SA
Switched active	Don't wire SA terminal	Loop the SA and A terminals	Wire to SA terminal
Unswitched active	Wire to terminal A	Wire to terminal A	Wire to terminal A
Neutral	Wire to terminal N	Wire to terminal N	Wire to terminal N
Earth	Wire to terminal E or	Wire to terminal E or	Wire to terminal E or

9. Verify that the battery is connected to the power pack. For Nexus LX or Nexus RF fitting; refer to the data connections section.
10. Fit the gear tray to the base, check and make sure no cable or wire obstruction around the retaining clip slots before locking the gear tray in place.
11. Energise the fitting and allow a few minutes to give the battery a small charge then press the test button to ensure the fitting is functional in emergency mode. Check the LEDs operation and indicator LED per following tables. Refer to the troubleshooting guide if abnormal operation or indication is encountered.
12. Fit the diffuser clips (if not already fitted) and then fit the diffuser, see figure 1.

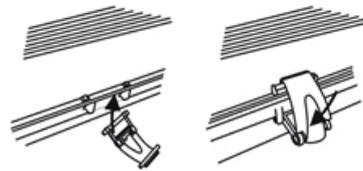


Figure 1: Diffuser clip diagram

Fitting type/fitting state	Normal operation	Test switch pressed (after few minutes charging)
Non-maintained	LEDs will be off	LEDs will turn on
Maintained - no SA	LEDs will be on	LEDs will go into emergency mode
Maintained - with SA	LEDs will follow the SA state	LEDs will go into emergency mode

Fitting type	Indicator LED state - on initial powering - no fitting faults
Non-monitored - SBLW	Solid green
Non-monitored - PBLW	Solid red
Nexus LX	Flashing green
Nexus RF	Green flash with 2 red blinks, green flash with 3 red blinks


Data connections

Nexus LX fitting

- Connect the data cable to the green connector on the power pack.
- When correctly installed no fitting should have more than 2 data cables connected to it.
- If you have more than 2 data cables at any 1 fitting, the installation is incorrect.
- If this fitting is at the end of a data cable run, a terminator needs to be wired parallel across the 2 data lines.
- If there is an in and out data cable, then the shields should be wound together, folded back and taped up.
- Consult the Nexus user and technical guide for further detail, including product commissioning.

Nexus RF fitting

- Collect the MAC address, by removing the peel off sticker section and locating it on your floor plan or spreadsheet.
- Consult the Nexus user and technical guide for further detail, including product commissioning.

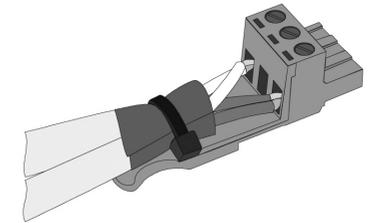

Important: 24 hours is required to allow the fitting battery to reach full capacity, ie: prior to a discharge test. As the installer, it is your responsibility to conduct the initial discharge testing of the installed fitting. Refer to AS/NZS 2293.

Motion detect sensor fitting

The motion detect sensor fitting uses a microwave motion sensor. The factory default motion sensor settings are:

- Detection area: 100%
- Hold-time: 90 seconds (in addition to the ballast hold-time of 30 seconds)
- Daylight sensor: disabled

The above settings can be changed. Please refer to a separate installation manual for the motion sensor settings, document number 29-BPSP003 provided with the product.

External occupancy detector/PIR

The fitting can also be used with external PIR/occupancy detector, the control output of PIR supply is connected to the active terminal for (AC fitting) and to the switched active terminal for (emergency fitting).

Note: For emergency fitting switched and un-switched lives must be on the same phase.

Removal instructions

1. Before removing the installed fitting, de-energise and lock off the supply circuit.
2. Remove the diffuser and unclip the gear tray from the base.
3. Disconnect the battery and then remove the mains cabling from the terminal block.
4. For Nexus LX; unplug the data cable connection. When the fitting is reconnected to the supply, it will need time to recharge its battery for 24 hours before it will be capable of a full length discharge again.